




## SPK-07 Horn Speaker - Installation Instructions

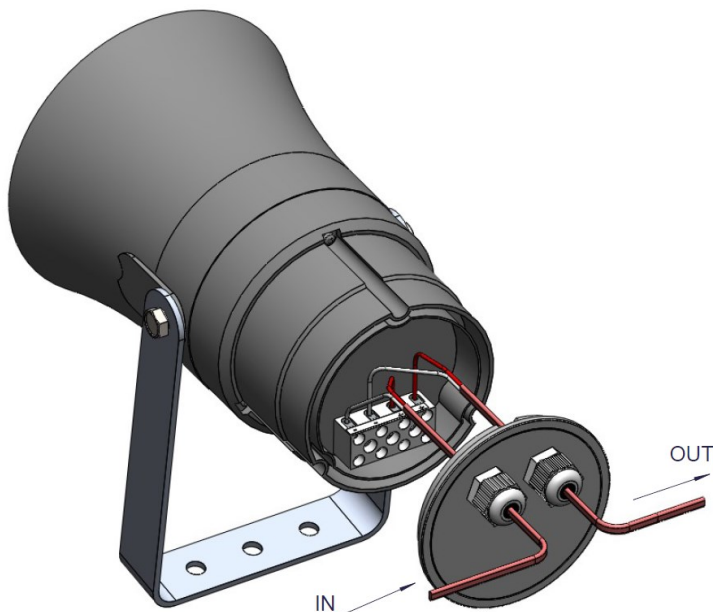


- 1) Remove the "U" shape bracket from the speaker and position where required on the wall or pole. Mark the fixing points and fix the bracket using suitable fixings (not supplied)

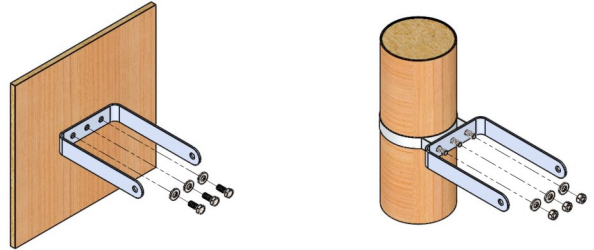

- 2) Determine which of the two rear covers supplied with the product best fits the installation cabling. The blank cover can be used with flexible conduit and requires an appropriate sized hole drilled.

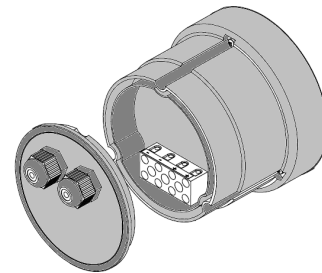


### Power Tapping

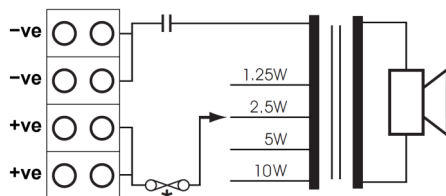


\* Optional Overload Fuse

- 3) Select the suitable power tapping using the rotary switch.

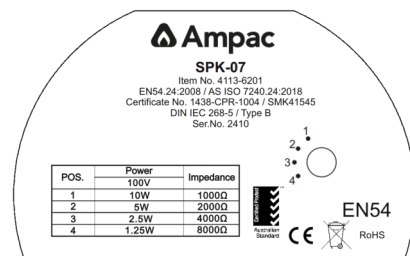

- 4) Feed the incoming cables through the compression cable gland fixings or flexible conduit and connect the wires to the terminal block of the speaker.



- 5) Refit the rear access cover using a rubber hammer to carefully ensure a watertight seal is maintained and not damaged.

- 6) Refit the speaker to the "U" bracket and position to the desired angle then tighten the fixings to secure in place.

	EN54-24:2008 1438-CPR-1004 DoP - AT-6113-6000
Loudspeaker for voice alarm systems for fire detection and fire alarm systems for buildings	
Horn Speaker, 10W SPK-07, Type B	
The Ampac Group of companies 7 Ledger Road, Balcatta, Western Australia 6021	
CE-Symbol according 93/68EWG CPR compliance according 305/2011/EU	
	AS ISO 7240.24:2018 SMK41545